

DX Series DIN-Rail Mount I/O Modules

DXI8 | DXO8 | DXR6 | DXV4 | DXIO

Specifications

| | |
|---------------------------|---|
| Input Power | 9-24Vdc, 1A MAX Class II / Limited Energy Power Supply |
| Max Switching Current | 1A per point |
| Max Switching Voltage | 24Vdc |
| Transistor Outputs | Sourcing FETS, 1A |
| PWM on Transistor Outputs | 6 Channels, 1kHz |
| Analog Inputs | 0-5Vdc / 0-20mA, 12-Bit Jumper Selectable |
| Analog Outputs | 0-10Vdc, 10mA max |
| Analog Sensor Power | 5Vdc, 500mA max (onboard) |
| Enclosure Knock-Outs | (2) dia. 7/8" |
| Enclosure Rating | TYPE 12 NEMA |
| Minimum Cycle Time | 1 second |
| Interface | GrowNET™, MODBUS |
| Terminal Wire Gauge | 26 - 16 AWG |
| Tightening Torque | 0.3-0.4 Nm |



Contents

| | | | |
|---------------------------------------|----------|---------------------------------------|-----------|
| Introduction | 2 | Connection to GrowControl™ GCX | 17 |
| Installation Instructions | 4 | GrowNET™ Hubs | 17 |
| Mounting the Modules | 4 | MODBUS RTU | 18 |
| DXI8 Terminals | 5 | Serial Speed & Format | 18 |
| DXO8 Terminals | 6 | Supported Commands | 18 |
| DXR6 Terminals | 7 | Register Types | 18 |
| DXV4 Terminals | 8 | MODBUS Holding Registers | 19 |
| DXIO Terminals | 9 | MODBUS Coil Registers | 20 |
| Input Connections, Discrete Sensors | 10 | Technical Information | 21 |
| Input Connections, Analog Sensors | 11 | Troubleshooting | 21 |
| Output Connections, DC FETS | 12 | Maintenance & Service | 21 |
| Output Connections, Dry Contacts | 13 | Storage and Disposal | 21 |
| Output Connections, Dry Contacts HVAC | 14 | Warranty | 21 |
| Output Connections, Analog Voltage | 15 | | |
| Output Connections, Gavita | 16 | | |

Introduction

GrowControl DX series digital I/O modules connect Agrowtek's intelligent controllers to devices in your growing environment.

DX modules are intended for:

- Driving electrical contactors and relays (dc coil)
- HVAC, dehumidifier control
- PWM or 0-10V control of light dimming and fan speeds
- Discrete and analog sensor inputs
- Miscellaneous control requirements

DX modules are available in a variety of I/O configurations:

| I/O Type | DXI8 | DXO8 | DXR6 | DXV4 | DXIO |
|--------------------------|------|------|------|------|------|
| Outputs (Transistor) | - | 8 | - | - | 2 |
| Outputs (Relay) | - | - | 6 | - | 2 |
| Outputs (Analog) | - | - | - | 4 | - |
| Inputs (Analog/Discrete) | 8 | - | - | 8 | 2 |

Inputs

DX modules with analog inputs allow connection of various analog or discrete sensors. Inputs are rated 0-5Vdc (or 0-20mA if current jumper is installed for the channel) and are 12 bit (4096 steps.) A 5Vdc 500mA power supply is included on board for powering analog sensors or providing a signaling voltage for discrete or dry-contact sensors.

| Typical Discrete Sensors | Typical Analog Sensors |
|--------------------------------------|------------------------|
| SXL Optical Liquid Detection Sensors | Moisture |
| Float Switches | Pressure |
| Door/Window Switches | Temperature |
| Flow Switches | Other |

Relay Outputs

Relay outputs are dry-contact form C with normally open and normally closed contacts. Dry contact relays operate like a wall switch simply connecting or disconnecting a pair of screw terminals. No voltage is provided from a relay output; only passed through when the contacts are closed. Dry contacts can switch AC or DC power. See the 'about relays' section for more detail.

Transistor Outputs


Heavy-duty transistor outputs with transient and flyback protection are designed to connect to DC contactor and relay coils for electrical panel control. Each transistor output is rated at 1A pilot duty (2A max total per unit) and will switch the supplied DC voltage out to the terminals. Heavy duty FET transistors offer robustness and reliability with ultra low heating, and are capable of limited PWM function.

Pulse Width Modulation (PWM)

The first six (6) transistor (FET) outputs may be operated in a 1kHz square-wave PWM (pulse width modulation) duty frequency between 10% and 90%. This allows integration with most lighting dimming controls and fan speed controls.

Duty values below 10% will be output as 0%.

Duty values above 90% will be output as 100%.

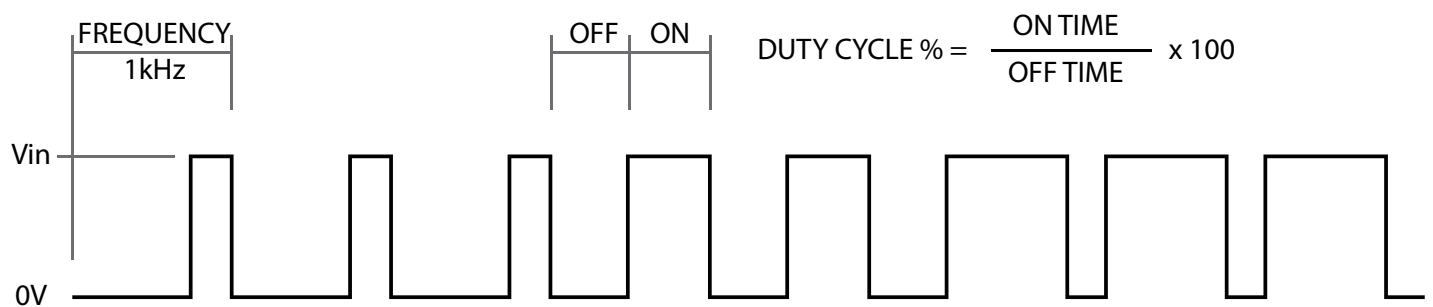

Installation Instructions

Read and follow these instructions to prevent bodily injury or property damage.

DANGER Electrocution Hazard

Disconnect all power sources before servicing or wiring. For continued protection against electric shock ensure the enclosure is properly grounded at the marked chassis ground terminal. Install all electrical equipment and wiring in accordance with national and local electric codes. For indoor use in dry locations only (0-80% RH non-condensing.)

Replace serviceable parts only with those recommended by Agrowtek Inc.


DANGER Risque d'électrocution

Débranchez toutes les sources d'alimentation avant l'entretien ou le câblage. Pour une protection continue contre les chocs électriques assurer l'enceinte est correctement reliée à la borne de terre du châssis marquée. Installez tous les équipements électriques et le câblage conformément aux codes électriques nationaux et locaux. Pour une utilisation en intérieur dans des endroits secs seulement (0-80% RH sans condensation.)

Remplacer les pièces réparable seulement avec ceux recommandés par Agrowtek Inc.

Mounting the Modules

DX series modules are designed for DIN rail mounting in electrical control cabinets and should be enclosed due to the exposed terminal design. If DIN rail is not available, brackets include mounting holes for surface mounting.

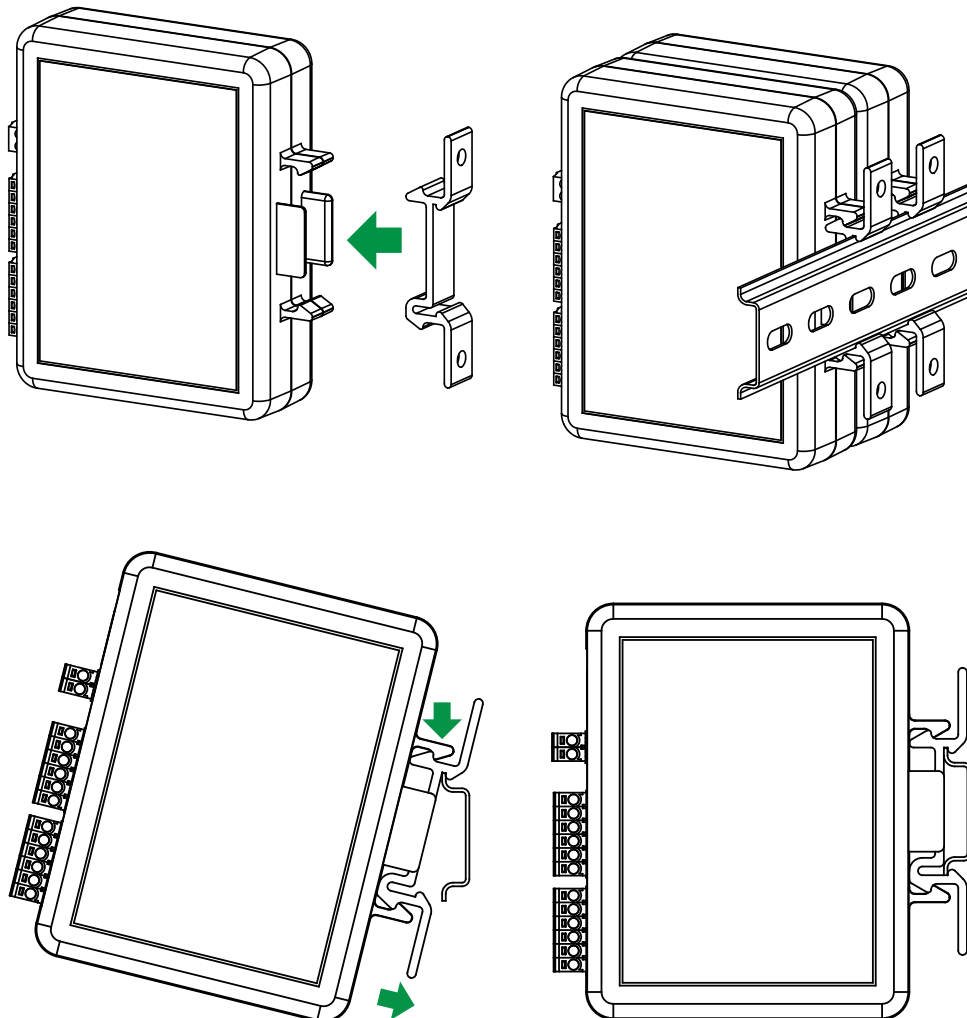


DXI8 Terminals

DXI8 modules feature eight (8) analog inputs for 0-5V or 0/4-20mA sensors. Inputs can also be used as discrete type. An on-board 5Vdc power supply provides up to 500mA of current to drive sensors and for use in discrete sensing applications.

DC power is optional on the DC power input terminals of this module.

Processor may be powered by the GrowNET™ RJ-45 port.

If using the onboard 5Vdc power supply it is recommended to provide DC power to the input terminals.

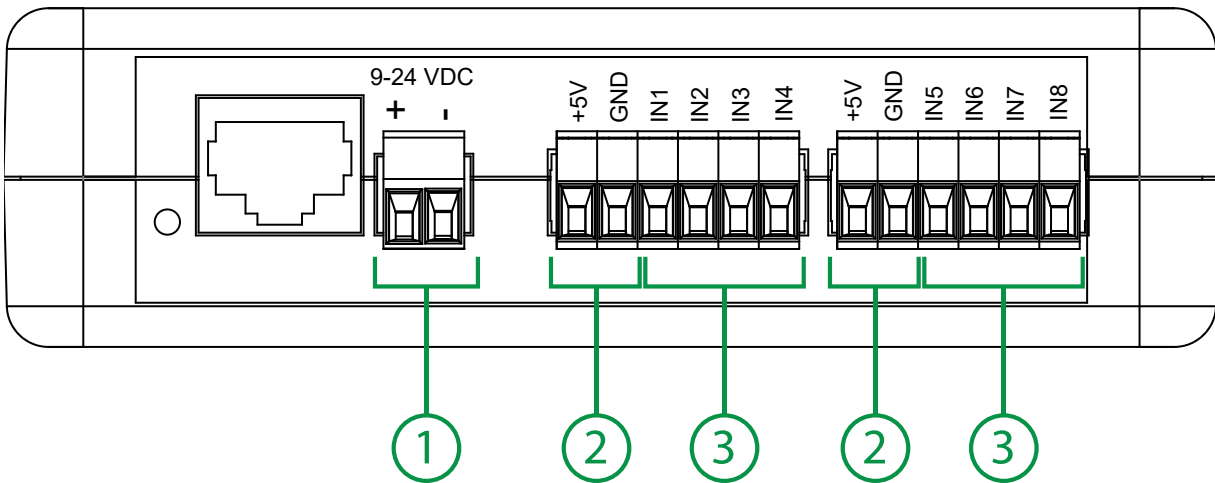

1. Vin

Vin terminals to provide DC power to the module and onboard 5Vdc power supply.

Power is optional on the DC power terminals.

2. 5Vdc Power Supply

Common 5Vdc power supply for driving sensors or for discrete sensing. Both pairs of terminals are supplied by a common 500mA switch mode power supply.

3. Inputs 1-8


Sinking inputs measure 0-5Vdc by default. Discrete sensors switch the supplied 5Vdc to an input to trigger it. Inputs may be configured for current sensing (0-20mA) by setting a jumper on the pcb inside of the module.

DXO8 Terminals

DXO8 modules feature eight (8) FET (transistor) outputs for providing DC power. Each fet is capable of 1A with a maximum device total of 8A.

DC power MUST be supplied to the DC power input terminals to power the outputs.

Processor may be powered by the GrowNET™ RJ-45 port.

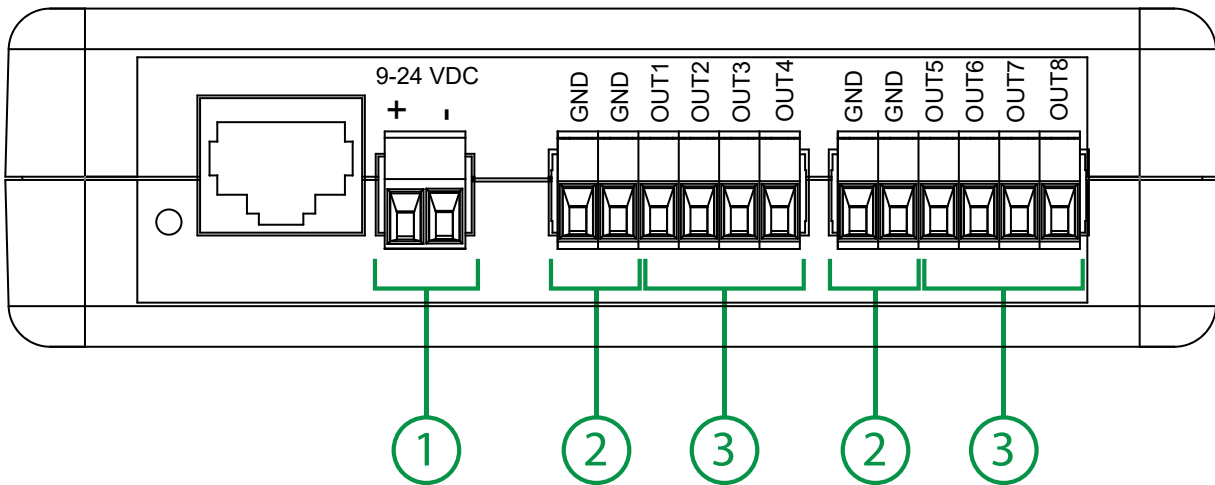

1. Vin

Vin terminals to provide DC power to the output terminals (OUT1 - OUT8).

Power must be provided at these terminals to drive the outputs.

2. GND

Common DC ground terminals for connections.


3. Outputs 1-8

Positive sourcing DC transistor outputs for driving solenoids, relays, contactors, etc. with a DC voltage. The first six (6) of the outputs can be configured for PWM control between 10-90% for motor speed control, light dimming, etc.

DXR6 Terminals

DXR6 modules feature six (6) normally open (N.O.) dry contact outputs for operating low-voltage control signals common in HVAC and other control applications. Each contact is capable of 1A at up to 48Vdc / 36 Vac.

Processor and relays are powered by the GrowNET™ RJ-45 port.

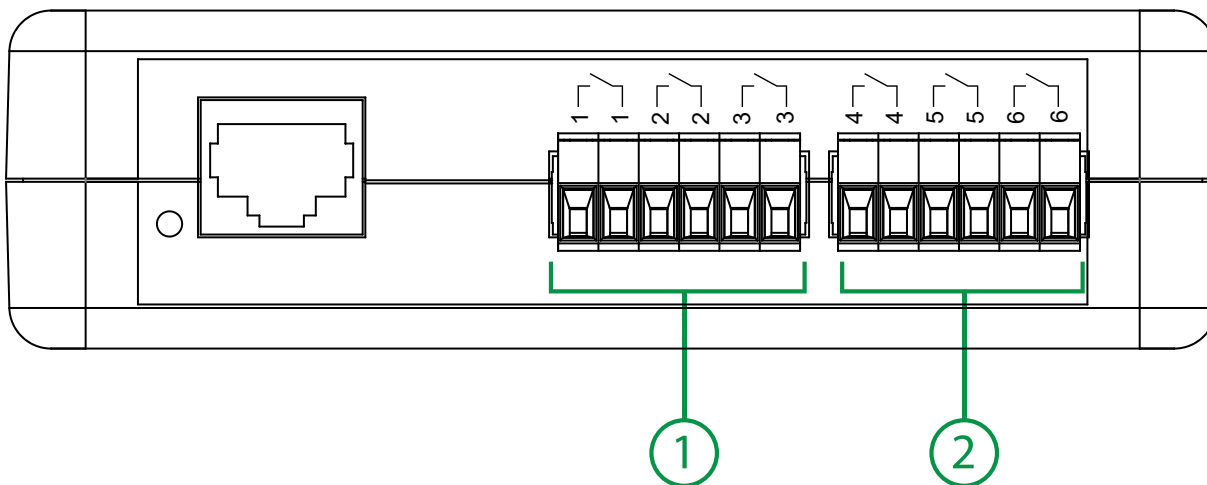

1. Relays 1 - 3

Relay contacts 1 through 3, normally open (form A.)

2. Relays 4 - 6


Relay contacts 4 through 6, normally open (form A.)

DXV4 Terminals

DXV4 modules feature four (4) analog 0-10Vdc outputs for operating ballast dimming signals, variable speed drives, and other devices with a analog voltage control input.

DC power MUST be supplied to the DC power input terminals to power the outputs.

Processor may be powered by the GrowNET™ RJ-45 port.

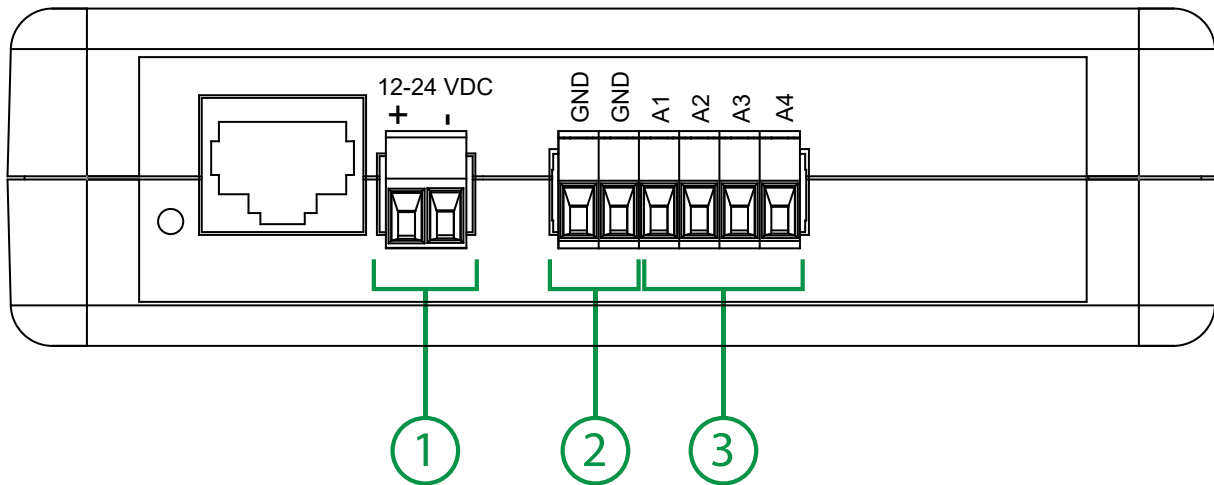

1. Vin

Vin terminals to provide DC power to the output terminals (A1 - A4).

Power must be provided at these terminals to drive the outputs.

2. GND

Common DC ground terminals for connections.

3. Analog Outputs 1-4

Positive sourcing DC outputs for driving lighting dimming controls and other equipment with a 0-10Vdc analog input. Each channel is capable of driving up to 50 light fixtures.

DXIO Terminals


DXIO modules feature a mix of I/O including:

- (2) FET (transistor) DC Outputs
- (2) Analog/Discrete Inputs
- (2) Form C Dry-Contact Relays

DC power is optional on the DC power input terminals of this module.

Processor may be powered by the GrowNET™ RJ-45 port.

If using the onboard 5Vdc power supply it is recommended to provide DC power to the input terminals.

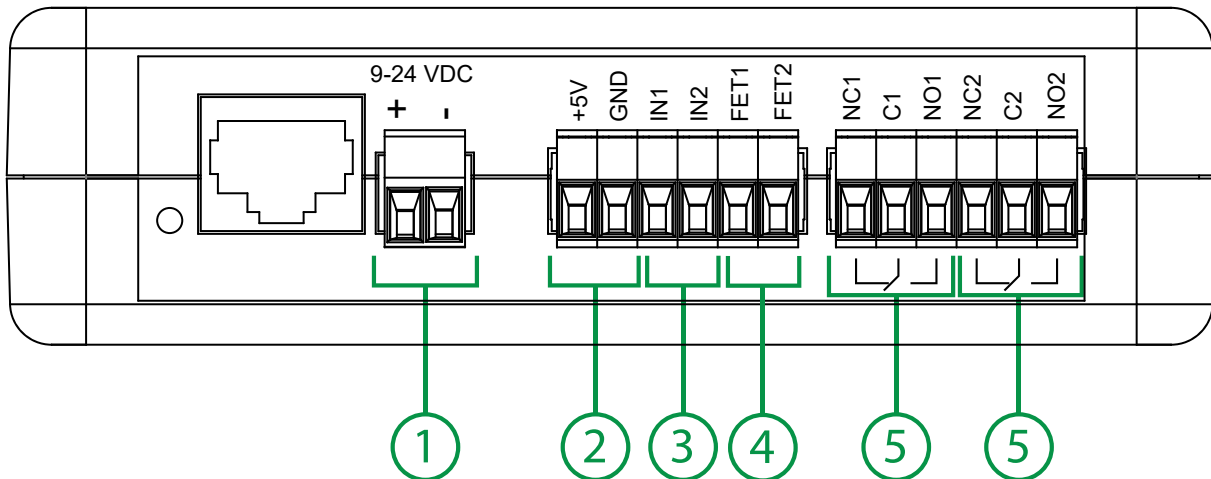

1. Vin

Vin terminals to provide DC power to the module, FET outputs, and onboard 5Vdc power supply.

Power is recommended when using the onboard 5V power supply.

2. 5Vdc Power Supply

Common 5Vdc power supply for driving sensors or for discrete sensing.

3. Inputs 1-2

Sinking inputs measure 0-5Vdc by default. Discrete sensors switch the supplied 5Vdc to an input to trigger it. Inputs may be configured for current sensing (0-20mA) by setting a jumper on the pcb inside of the module.

4. Outputs 1-2 (DC transistor)

Positive sourcing DC transistor outputs for driving solenoids, relays, contactors, etc. with a DC voltage. The outputs can be configured for PWM control between 10-90% for motor speed control, light diming, etc.

5. Outputs 3-4 (dry contact relay)

Form C (N.C./N.O.) 10A dry contacts for switching A.C. including HVAC signals and irrigation valves.

Input Connections, Discrete Sensors


Discrete type sensors offer only an indication of “true” or “false” and no information in between. Typical examples include liquid presense detection sensors, manual and proximity switches, door and window switches, etc.

Passive Sensors

Passive sensors are simple, typically mechanical sensors that manipulate a physical switch (dry contact) to close a circuit. Passive sensors do not have any electronics on board and simply pass through the signal voltage when the condition is true. Passive sensors only require two wires; the signal voltage and the sensor output.

Active Sensors

Active sensors have electronics on board and require both a power and ground wire to operate the sensor, plus a third wire to carry the output signal of the sensor.

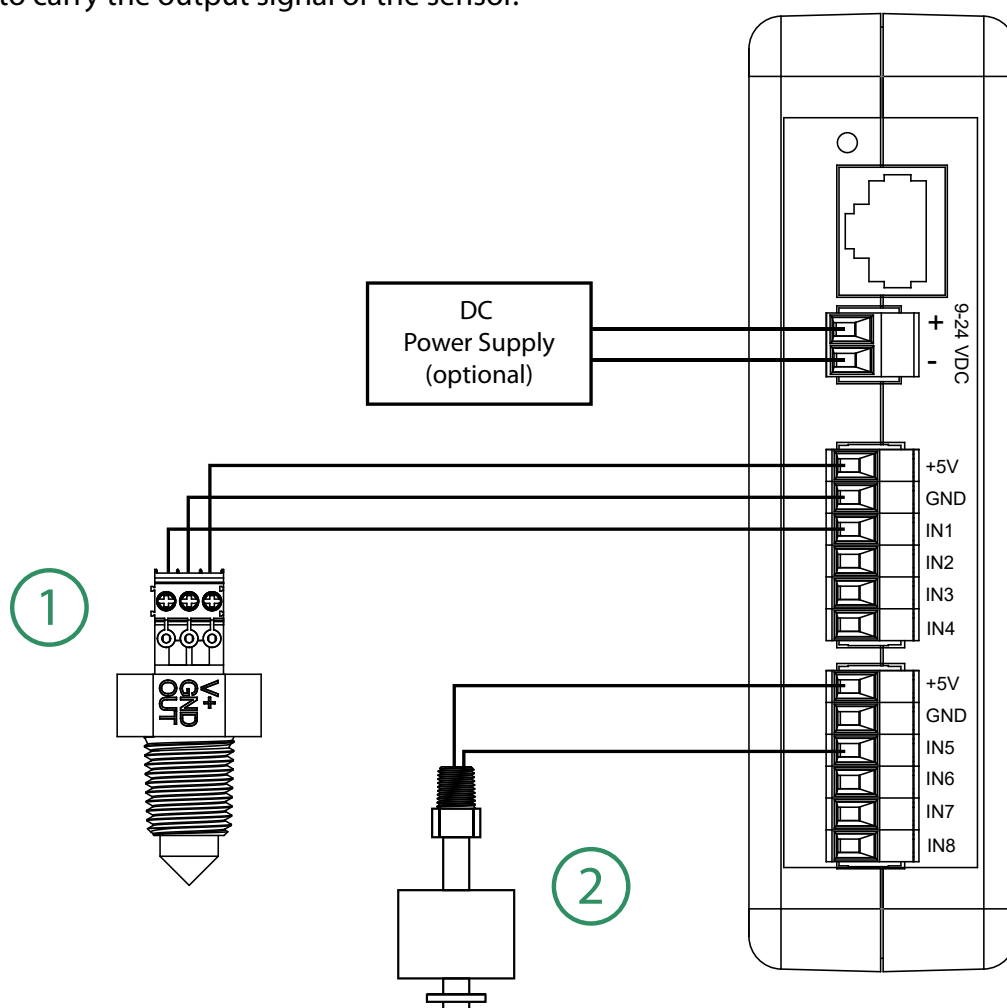

1. SXL Optical Liquid Sensor (powered sensor)

Requires three wires; V+, GND and signal output.

Connect the output of the sensor to the desired input terminal.

2. Float Switch (dry contact sensor)

Requires two wires; V+ and signal output. Connect the output of the sensor to the desired input terminal.

Input Connections, Analog Sensors

Analog sensors offer a “variable” value such as a temperature, pressure, etc. The device’s analog inputs are 12 bit and offer 4096 steps of resolution (1.22mV or 0.005mA.) Each input has a default range in “Voltage” mode of 0-5Vdc, or if set with a jumper to a “Current” mode, a 0-20mA range.


Voltage Mode

Standard mode for 0-5Vdc analog sensors or discrete type sensors.

Current Mode

Mode for 0-20mA or 4-20mA type industrial analog sensors.

Note: Jumpers must be installed on the PCB for mA mode.

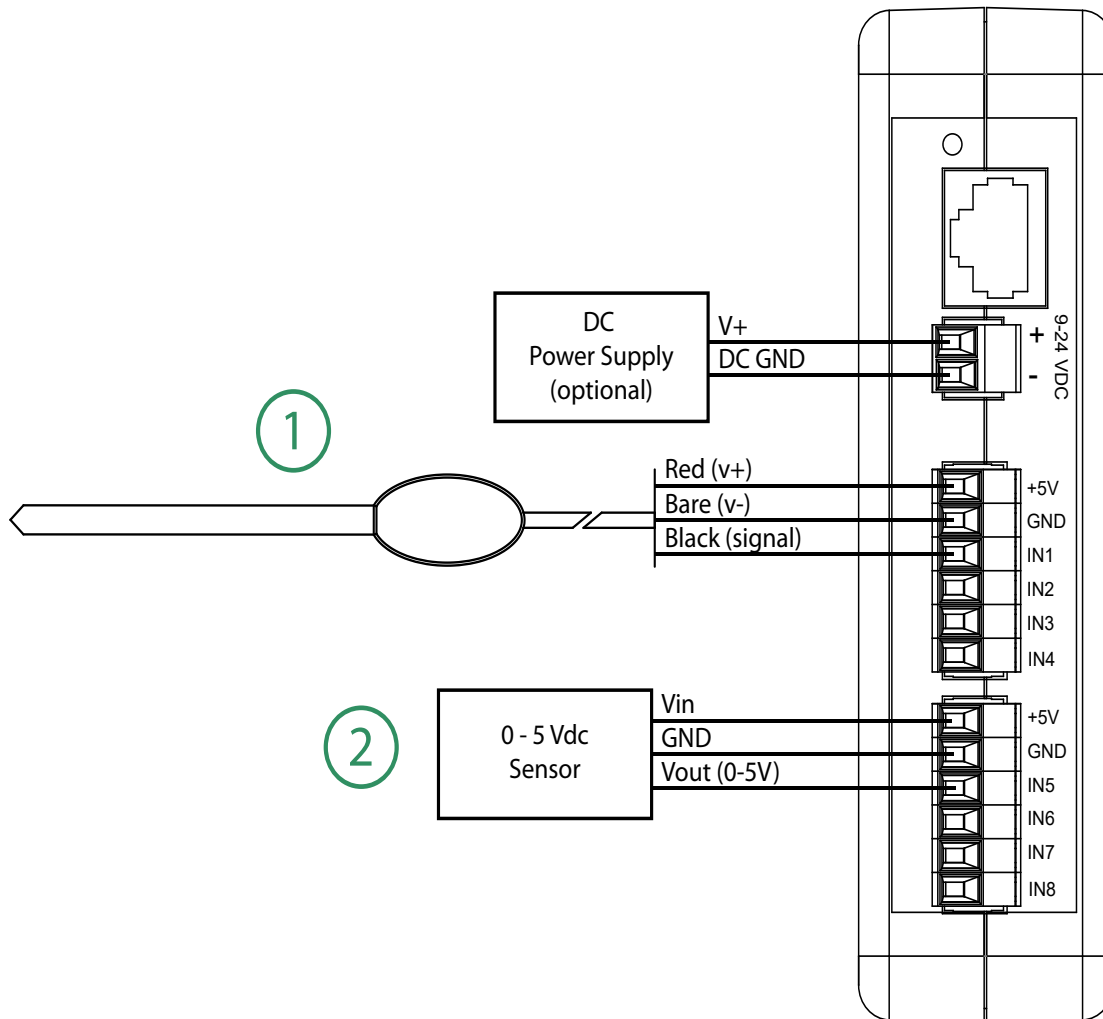

1. SXM-1 Soil Moisture Sensor (0-5V)

Requires three wires; V+, GND and signal output.


Connect the output of the sensor (black wire) to the desired input terminal.

2. 0-5V DC Sensor

Any standard three-wire 0-3V or 0-5V sensor can be integrated into a DXI8 module.

Output Connections, DC FETS

High current FET (transistor) outputs control DC loads. DXO8 and DXIO modules switch the voltage that is supplied to the unit at the Vin terminal block to the DC output terminals. Power is required at the Vin terminal block to supply the outputs with power. The default power supply is 24Vdc. Lower voltage may be supplied to the board (down to 9Vdc) depending on the requirements of the devices being driven.

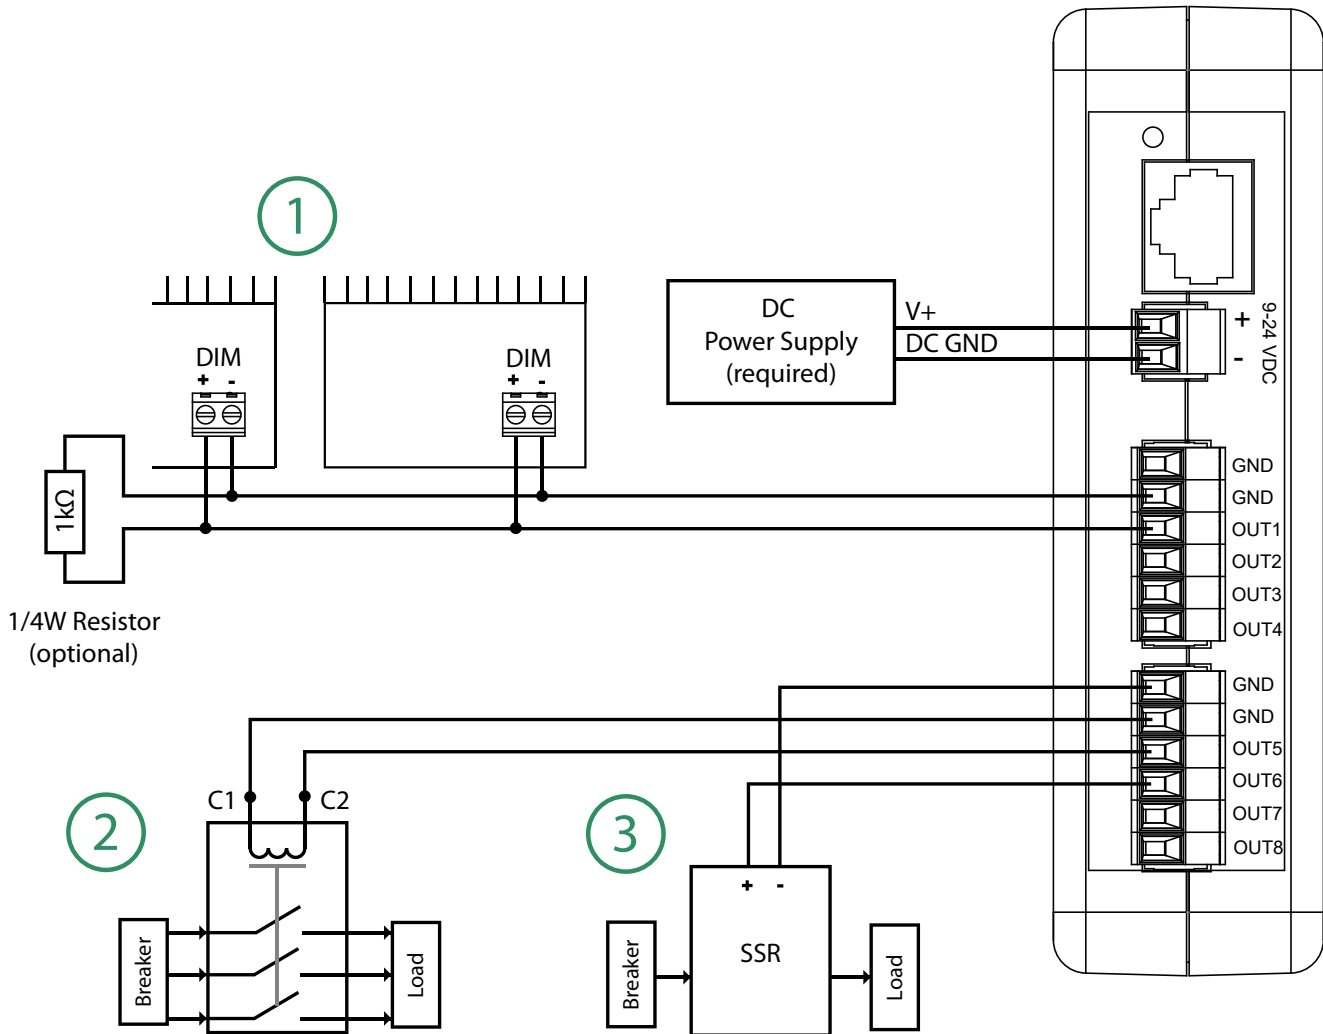

1. Dimmable Ballasts & VFD Motor Controllers

Ballasts and VFD controllers that accept a 1kHz PWM signal may be controlled by the first six (6) output channels for variable speed motor control or variable intensity lighting control. Each of the six channels operate at 1kHz but may be set to 0, 5-100% duty independently. A 1kOhm terminating resistor may be required to pull down the pwm signal if dimming is not functioning properly.

2. Electromechanical Relays & Contactors


DC powered relays and contactors with magnetic coils may be driven directly by the outputs. Each output is protected for flyback and surge, and is capable of up to 1A continuous current (1A max combined current.)

3. Solid State Relays

DC powered solid state relays (SSR's) may be driven by the DC output terminals.

Output Connections, Dry Contacts

Dry-contact relays consist of a mechanical switch (contact) and an electro-magnet to turn-on (close) the switch contact. A spring opens the switch when the electromagnet is no longer powered. The contact switch operates the same way as a wall-switch, connecting two screw terminals together. Dry contacts are typically used for switching low-voltage AC control signals including HVAC units and irrigation solenoids.

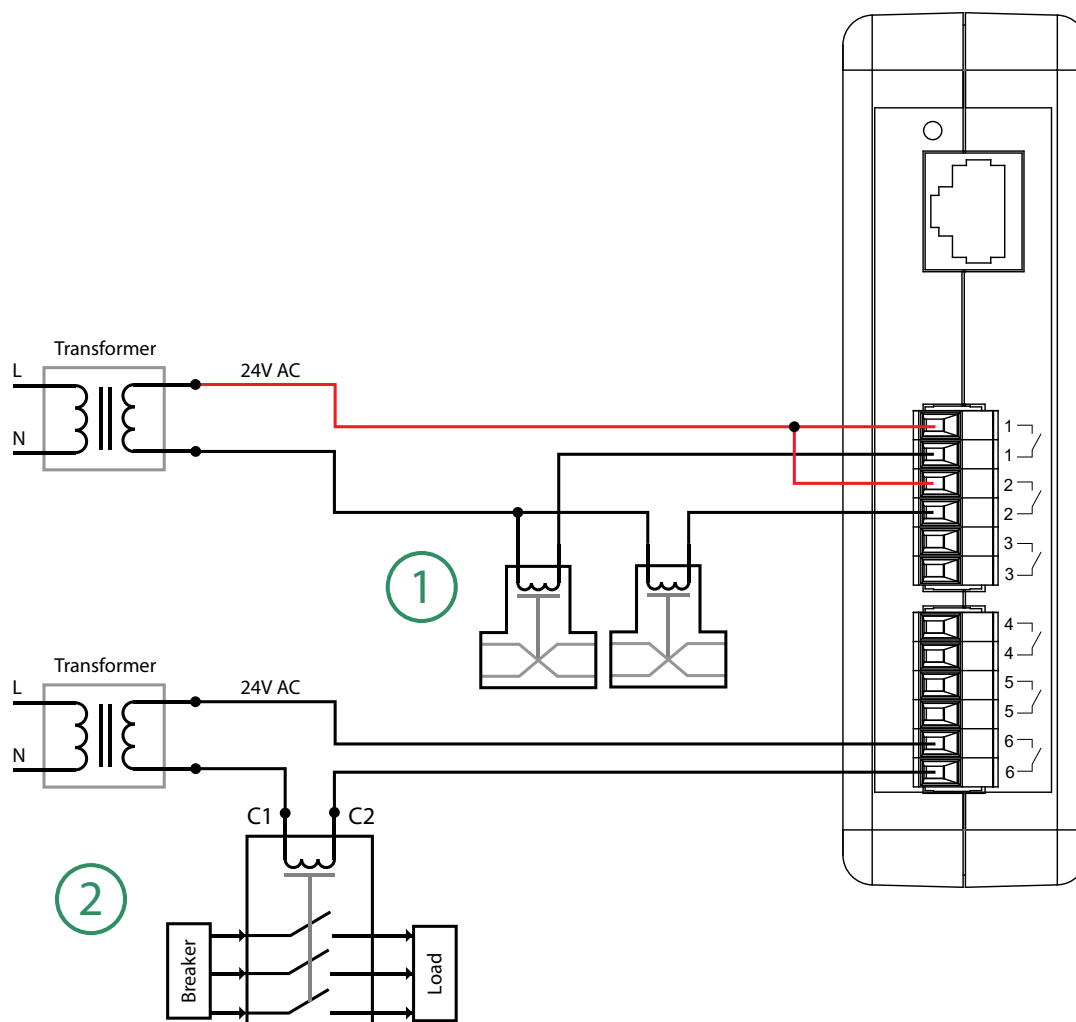

1. Irrigation Solenoid Valves


24VAC irrigation and gas valves can be controlled by switching power supplied by a step-down transformer. *24VAC is safer and more common than line-voltage for water/irrigation solenoids.*

2. A.C. Coil Relays & Contactors

Contactors and relays with 24VAC coils can be operated by controlling the power from a transformer to the magnet coil with a dry contact switch.

Output Connections, Dry Contacts HVAC

HVAC units typically supply 24VAC from a built-in control transformer located in the HVAC unit. The 24VAC supplied by the FCU is switch to the various control signal wires back to the FCU inputs activating the HVAC unit. Dry contacts are required to switch the AC control voltage in HVAC and commercial dehumidifier units.

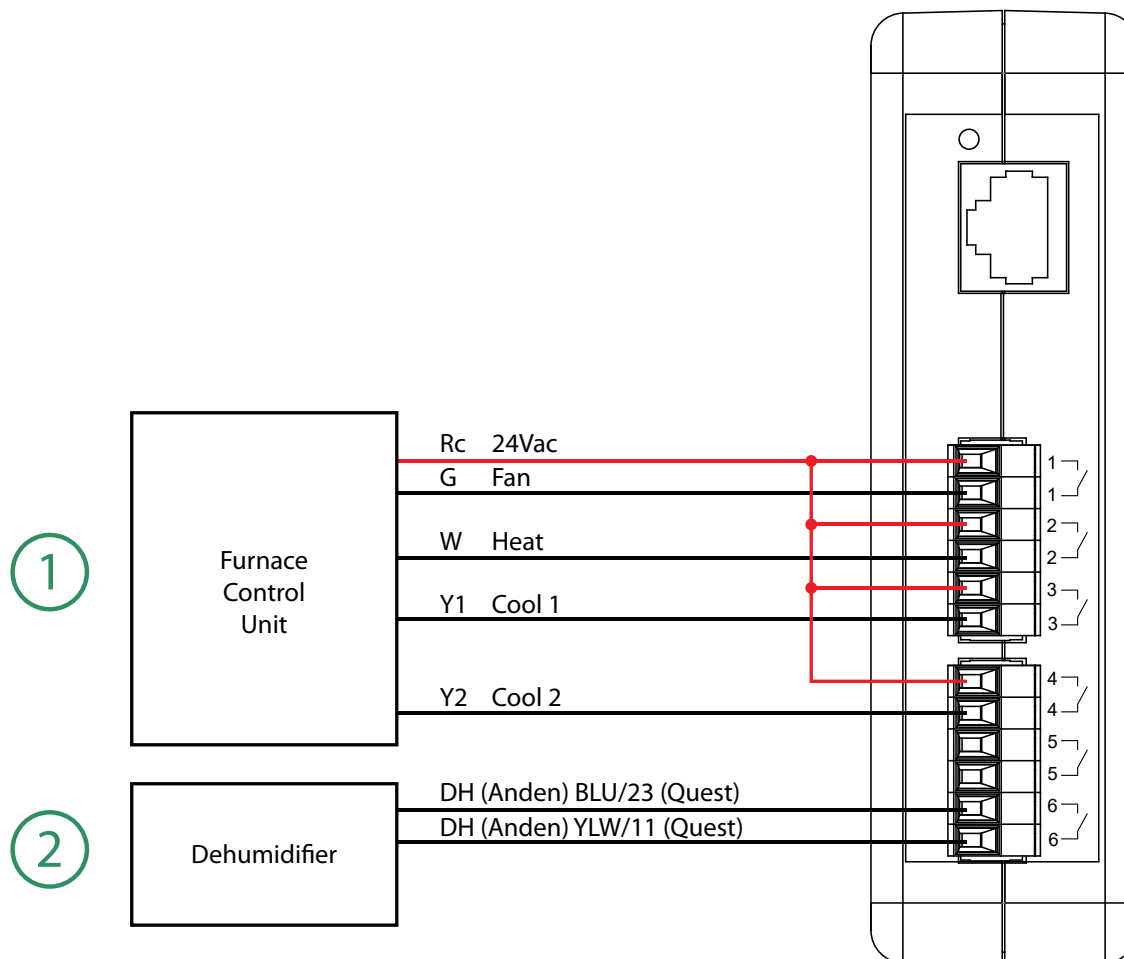

1. HVAC FCU


Typical example of connections to a RTU (roof top unit) HVAC system FCU (furnace control unit.)

2. Humidifiers & Dehumidifiers

Commercial humidifiers and dehumidifiers typically provide both an economical internal humidistat control and terminals for external humidistat control. Contact your equipment manufacturer or review your equipment installation manual for details on which connections to make for dry-contact external control.

Output Connections, Analog Voltage

Analog voltage outputs are designed for analog signal control primarily in light dimming and speed control applications. Power is required at the Vin terminal block to supply the outputs with power. The power supply must be in the range of 12-24Vdc. Up to 50 fixtures (typical) may be driven from a single output channel.

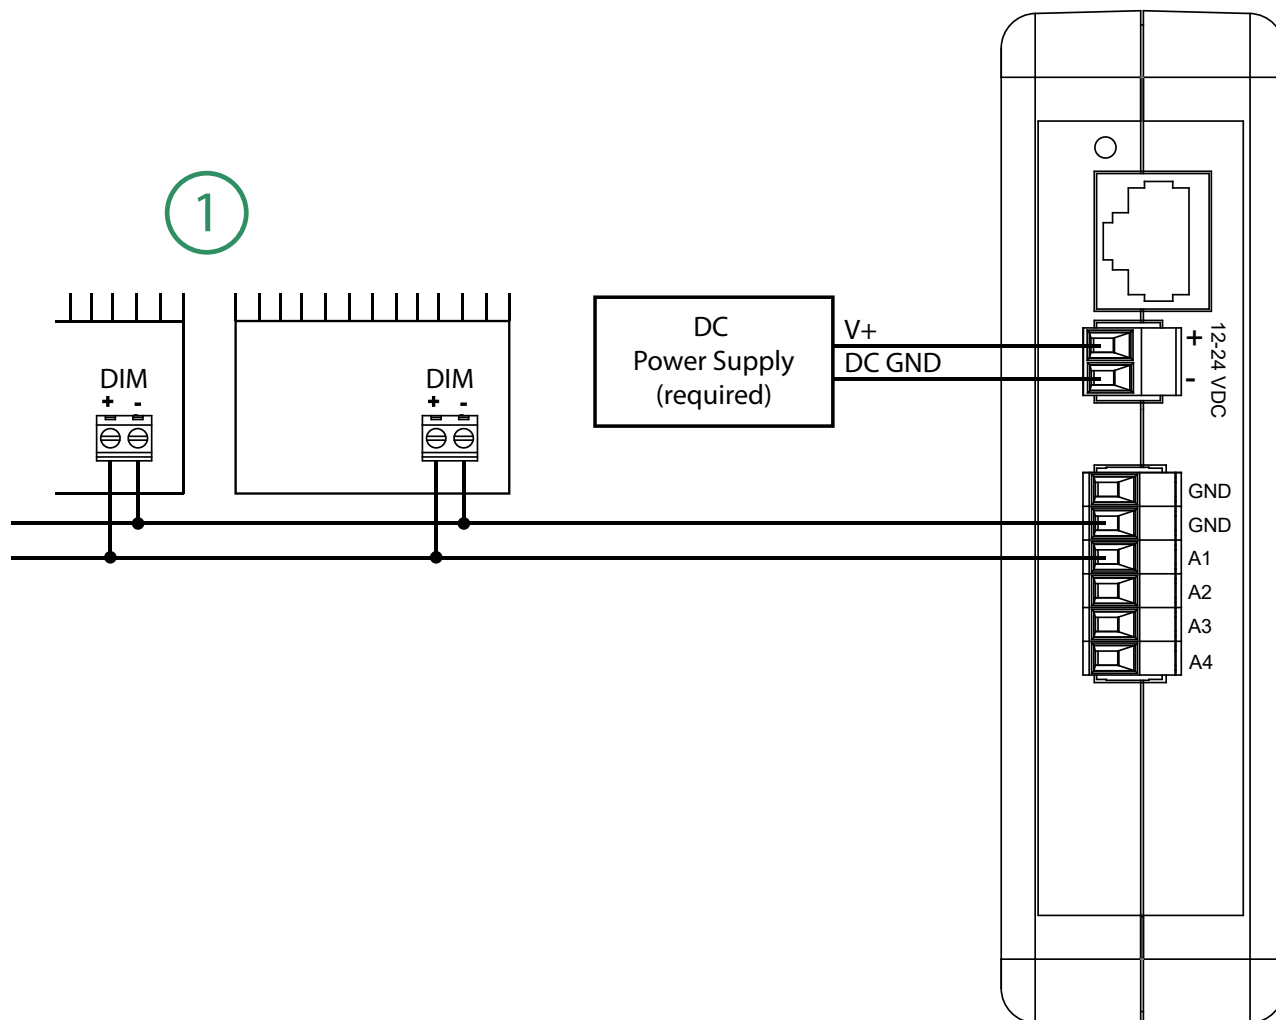


1. Dimmable Ballasts & VFD Motor Controllers

Ballasts and VFD controllers that accept a 0-10V signal may be controlled by one of four (4) analog voltage output channels. Each of the four channels may be set to 0-10Vdc independently. Internal feedback sensing manages voltage levels automatically accounting for unit loading.

Output Connections, Gavita

Gavita fixtures use a RJ-45 connector.

The connections from a standard RJ-45 connector to the DXV4 are detailed below.

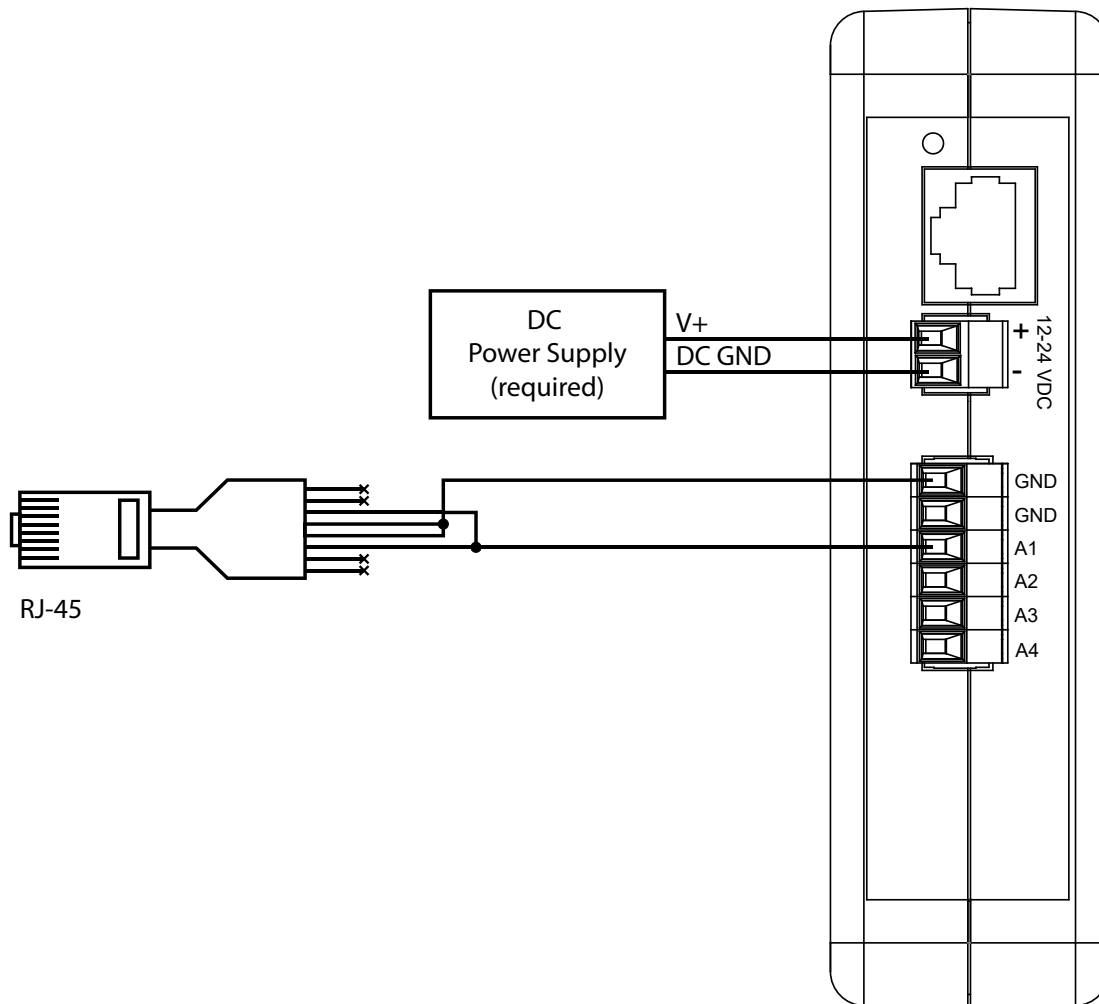


1. Dimmable Ballasts & VFD Motor Controllers

Ballasts and VFD controllers that accept a 0-10V signal may be controlled by one of four (4) analog voltage output channels. Each of the four channels may be set to 0-10Vdc independently. Internal feedback sensing manages voltage levels automatically accounting for unit loading.

Connection to GrowControl™ GCX

All GrowNET™ devices are connected using standard CAT5 Ethernet cable with RJ-45 connections.

Devices can be connected directly to the GrowNET™ ports on the bottom of the controller, or through HX8 GrowNET™ hubs. It is typical to simplify cabling by locating hubs centrally in hall ways and rooms allowing single runs from an 8-port device hub back to a central hub or back to the controller.

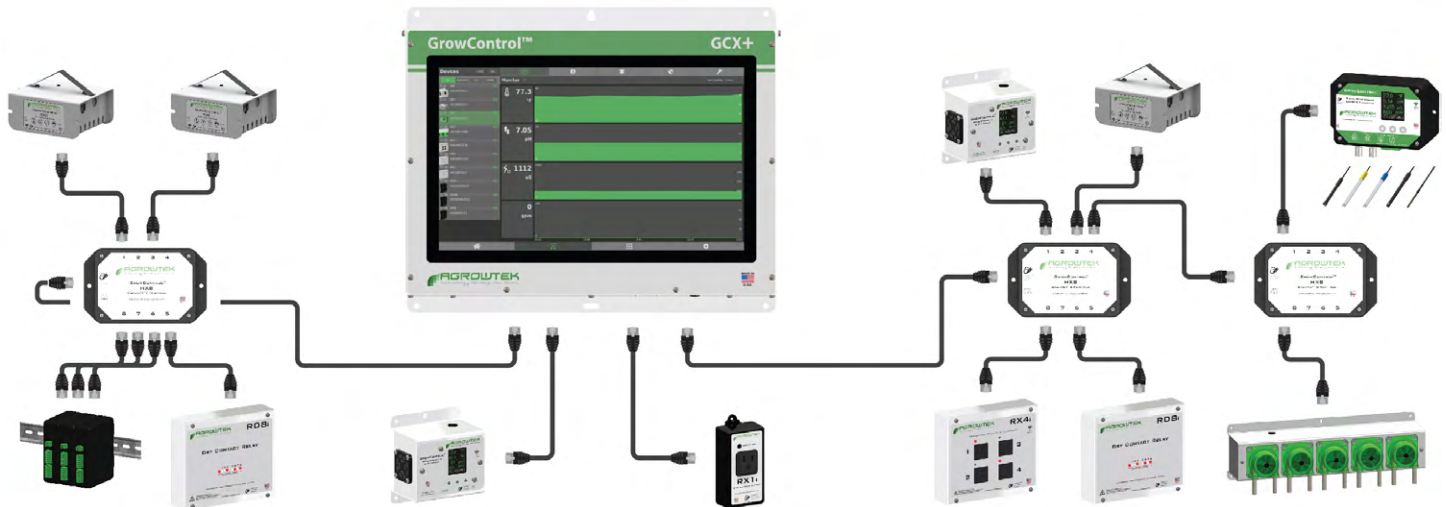

Refer to the GCX controller manual for details on adding the device to the system.

GrowNET™ Hubs

HX8 GrowNET™ hubs expand a single port into eight more ports. Hubs can be daisy-chained to form a network of up to 100 devices per GrowNET™ bus. Individually buffered port transceivers provide excellent signal integrity and extended communication strength and range.

Hubs provide up to 1A of power for operating sensors and most relays directly over the CAT5 cable. A DC jack on the hub provides 24Vdc power to the ports from the included wall power supply. A terminal block power option is also available.



Installation Notes

⚠ NOTICE

GrowNET™ ports use standard RJ-45 connections but are NOT compatible the Ethernet network equipment. *Do not connect GrowNET™ ports to Ethernet ports or network switch gear.*

⚠ DIELECTRIC GREASE


Dielectric grease is recommended on RJ-45 GrowNET™ connections when used in humid environments. Place a small amount of grease onto the RJ-45 plug contacts before inserting into the GrowNET™ port. *Non-conductive grease is designed to prevent corrosion from moisture in electrical connectors.*

- Loctite LB 8423
- Dupont Molykote 4/5
- CRC 05105 Di-Electric Grease
- Super Lube 91016 Silicone Dielectric Grease
- Other Silicone or Lithium based insulating grease

MODBUS RTU

RS-485

Use the LX2 ModLINK to connect MODBUS devices to the GrowNET™ port.

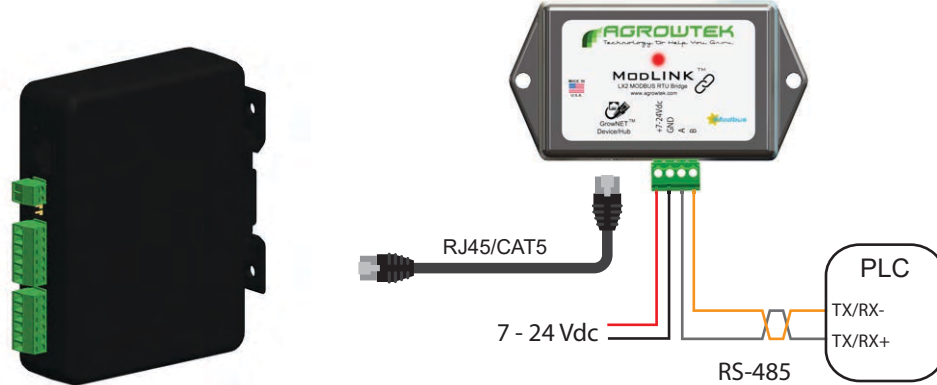



3.3/5Vdc Serial Bus Compatible.

Include required bus terminating resistors per EIA standard.

Serial Speed & Format

The default serial data format for the LX2 ModLINK interface is: **19,200 baud, 8-N-1.**

Alternate speeds and formats between 9,600 - 115,200 baud may be configured with the free AgrowLINK PC utility using a LX1 USB AgrowLINK and the cross-over adapter supplied with the LX2 ModLINK.

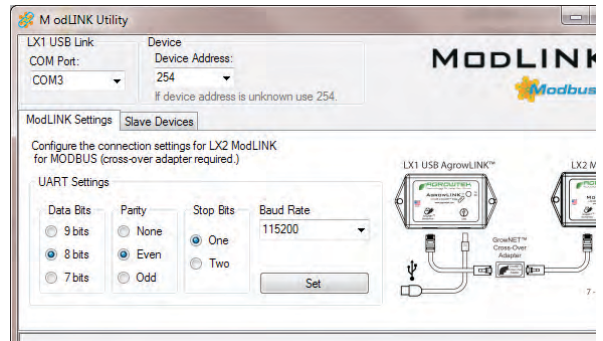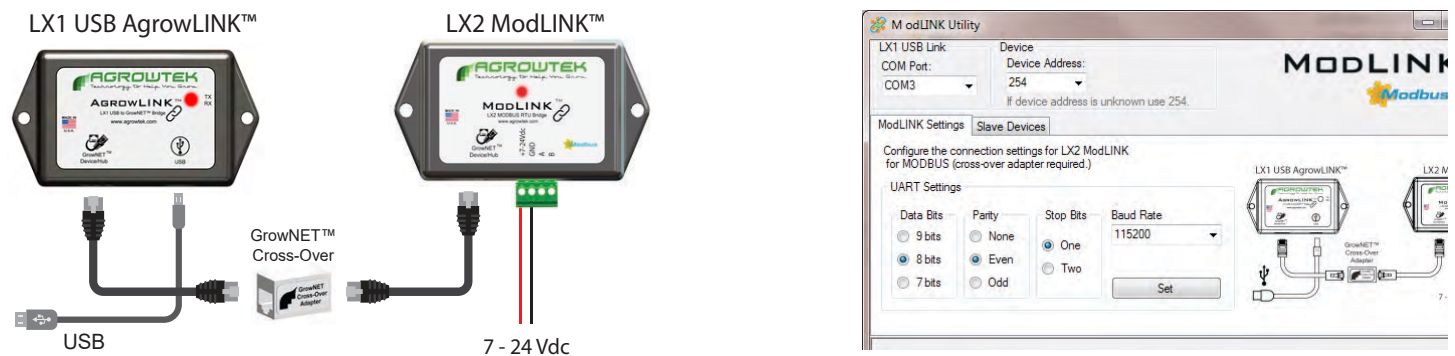

Supported Commands

- 0x01 Read Coils
- 0x03 Read Multiple Registers
- 0x05 Write Single Coil
- 0x06 Write Single Register
- 0x15 Write Multiple Coils

A request to use a function that is not available will return an illegal function error (0x01).

Register Types

Data registers are 16 bits wide with addresses using the standard MODICON protocol. Floating point values use the standard IEEE 32-bit format occupying two contiguous 16 bit registers. ASCII values are stored with two characters (bytes) per register in hexadecimal format. Coil registers are single bit values which control and indicate the status of a relay; 1 = on, 0 = off.

MODBUS Holding Registers

| Parameter | Description | Range | Type | Access | Address |
|------------------------------------|--------------------------------------|----------------|------------------|--------|---------|
| Address | Device Slave Address | 1 - 247 | 8 bit | R/W | 40001 |
| Serial# | Device Serial Number | ASCII | 8 char | R | 40004 |
| DOM | Date of Manufacture | ASCII | 8 char | R | 40008 |
| HW Version | Hardware Version | ASCII | 8 char | R | 40012 |
| FW Version | Firmware Version | ASCII | 8 char | R | 40016 |
| Device Model | Product Model Number | ASCII | 8 char | R | 40020 |
| Analog Input Value, Integer | Input 1 | Signed Int | 16 bit, signed | R | 40101 |
| | Input 2 | | | | 40102 |
| | Input 3 | | | | 40103 |
| | Input 4 | | | | 40104 |
| | Input 5 | | | | 40105 |
| | Input 6 | | | | 40106 |
| | Input 7 | | | | 40107 |
| | Input 8 | | | | 40108 |
| Analog Input Value, Floating Point | Input 1 | Floating Point | 32 bit, float | R | 40201 |
| | Input 2 | | | | 40203 |
| | Input 3 | | | | 40205 |
| | Input 4 | | | | 40207 |
| | Input 5 | | | | 40209 |
| | Input 6 | | | | 40211 |
| | Input 7 | | | | 40213 |
| | Input 8 | | | | 40215 |
| PWM Output, Duty Cycle % | Output 1 | 0-100 | 16 bit, signed | R/W | 40301 |
| | Output 2 | | | | 40302 |
| | Output 3 | | | | 40303 |
| | Output 4 | | | | 40304 |
| | Output 5 | | | | 40305 |
| | Output 6 | | | | 40306 |
| Timeout (seconds) | Turn off outputs if no communication | 0 - 32767 | 16 bit, unsigned | R/W | 41001 |
| Output Closure Count, Discrete | Output 1 | Unsigned Int | 32 bit, unsigned | R | 49001 |
| | Output 2 | | | | 49003 |
| | Output 3 | | | | 49005 |
| | Output 4 | | | | 49007 |
| | Output 5 | | | | 49009 |
| | Output 6 | | | | 49011 |
| | Output 7 | | | | 49013 |
| | Output 8 | | | | 49015 |

MODBUS Coil Registers

| Parameter | Access | Address |
|-----------|--------|---------|
| Relay 1 | R/W | 1 |
| Relay 2 | R/W | 2 |
| Relay 3 | R/W | 3 |
| Relay 4 | R/W | 4 |
| Relay 5 | R/W | 5 |
| Relay 6 | R/W | 6 |
| Relay 7 | R/W | 7 |
| Relay 8 | R/W | 8 |

A request to read or write coils/registers that are not available will return an illegal address error (0x02.)

Technical Information

Troubleshooting

Outputs are not activating, LED does not flash

The status LED will flash three times on power-up and each time data is transmitted.

Ensure the input power has 9-24Vdc and are correctly wired for polarity.

Maintenance & Service

Exterior Cleaning

Exterior may be wiped with a damp cloth with mild dish detergent, then wiped dry. Disconnect power before cleaning the enclosure to prevent electrical shock.

Storage and Disposal

Storage

Store equipment in a clean, dry environment with ambient temperature between 10-50°C.

Disposal

This industrial control equipment may contain traces of lead or other metals and environmental contaminants and must not be discarded as unsorted municipal waste, but must be collected separately for the purpose of treatment, recovery and environmentally sound disposal. Wash hands after handling internal components or PCB's.

Warranty

Agrowtek Inc. warrants that all manufactured products are, to the best of its knowledge, free of defective material and workmanship and warrants this product for 1 year from the date of purchase. This warranty is extended to the original purchaser from the date of receipt. This warranty does not cover damages from abuse, accidental breakage, or units that have been modified, altered, or installed in a manner other than that which is specified in the installation instructions. Agrowtek Inc. must be contacted prior to return shipment for a return authorization. No returns will be accepted without a return authorization. This warranty is applicable only to products that have been properly stored, installed, and maintained per the installation and operation manual and used for their intended purpose. This limited warranty does not cover products installed in or operated under unusual conditions or environments including, but not limited to, high humidity or high temperature conditions. The products which have been claimed and comply with the aforementioned restrictions shall be replaced or repaired at the sole discretion of the Agrowtek Inc. at no charge. This warranty is provided in lieu of all other warranty provisions, express or implied. It is including but not limited to any implied warranty of fitness or merchantability for a particular purpose and is limited to the Warranty Period. In no event or circumstance shall Agrowtek Inc. be liable to any third party or the claimant for damages in excess of the price paid for the product, or for any loss of use, inconvenience, commercial loss, loss of time, lost profits or savings or any other incidental, consequential or special damages arising out of the use of, or inability to use, the product. This disclaimer is made to the fullest extent allowed by law or regulation and is specifically made to specify that the liability of Agrowtek Inc. under this limited warranty, or any claimed extension thereof, shall be to replace or repair the Product or refund the price paid for the Product.